




150002281904



(2015)建材质监认字(17)号



中国认可  
国际互认  
检测  
TESTING  
CNAS L1449

# 检 验 报 告

## TEST REPORT

报告编号: JS2019TD1453



样品名称: PVC-U电工套管

Sample Name

委托单位: 京华塑业有限公司


Applicant

检验类别: 委托检验

Test Type

国家建筑材料工业建筑围护材料及管道产品质量监督检验测试中心

National Building Material Industry Enclosure Material and Pipeline Production Quality Supervision and Test Center

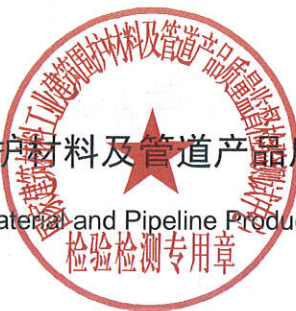



## 检 验 报 告 (TEST REPORT)

报告编号№: JS2019TD1453

第 1 页 共 2 页

|                                                    |                                                                                                         |                         |             |
|----------------------------------------------------|---------------------------------------------------------------------------------------------------------|-------------------------|-------------|
| 委托单位<br>Applicant                                  | 京华塑业有限公司                                                                                                | 检验类别<br>Test Type       | 委托检验        |
| 受检单位<br>Inspected Entity                           | ——                                                                                                      | 委托日期<br>Consign Date    | 2019年12月16日 |
| 工程名称及使用部位<br>Engineering Name and Application Part | ——                                                                                                      | 来样日期<br>Accept Date     | 2019年12月16日 |
| 样品名称<br>Sample Name                                | PVC-U电工套管                                                                                               | 样品数量<br>Sample Quantity | 1.2m×10根    |
| 型号/规格<br>Type/Specification                        | GY. 415-16                                                                                              | 样品等级<br>Grade           | ——          |
| 生产单位<br>Manufacturer                               | 京华塑业有限公司                                                                                                | 样品状态<br>Sample State    | 完好          |
| 生产日期/批号<br>Production Date/Lot №                   | 2019年12月07日                                                                                             | 商标<br>Trade Mark        | 京华          |
| 检验依据<br>Ref Documents                              | 详见数据页                                                                                                   |                         |             |
| 判定依据<br>Decision Documents                         | JG/T 3050-1998 《建筑用绝缘电工套管及配件》                                                                           |                         |             |
| 检验项目<br>Test Item                                  | 规格尺寸, 抗压性能, 阻燃性能, 电气性能                                                                                  |                         |             |
| 检验结论<br>Test Conclusion                            | <p>该样品经检验, 所检项目符合JG/T 3050-1998 《建筑用绝缘电工套管及配件》的指标要求。</p> <p>签发日期: 2020年01月20日<br/>Issued by (Stamp)</p> |                         |             |
| 附注<br>Remarks                                      | <p>本检验结果仅对来样负责。检验检测专用章</p>                                                                              |                         |             |

 批 准:   
 Approved by:

 审 核:   
 Inspected by:

 主 检:   
 Tested by:

## 国家建筑材料工业建筑围护材料及管道产品质量监督检验测试中心

## 检 验 报 告 (TEST REPORT)

报告编号№: JS2019TD1453

第 2 页 共 2 页

| 序号 | 检验项目    |                  | 检验依据                               | 指标要求       | 检验结果       | 单项判定 |
|----|---------|------------------|------------------------------------|------------|------------|------|
| 1  | 规格尺寸    | 最大外径             | JG/T 3050-1998                     | 量规自重通过。    | 量规自重通过。    | 符合   |
|    |         | 最小外径             | JG/T 3050-1998                     | 量规不能通过。    | 量规不能通过。    | 符合   |
|    |         | 最小内径             | JG/T 3050-1998                     | 量规自重通过。    | 量规自重通过。    | 符合   |
|    |         | 最小壁厚, mm         | JG/T 3050-1998                     | $\geq 1.0$ | 1.5        | 符合   |
| 2  | 抗压性能, % | 载荷               | JG/T 3050-1998                     | $\leq 25$  | 18         | 符合   |
|    |         | 卸荷               | JG/T 3050-1998                     | $\leq 10$  | 3          | 符合   |
| 3  | 阻燃性能    | 自熄时间, s          | JG/T 3050-1998                     | $\leq 30$  | 4          | 符合   |
|    |         | 氧指数, %           | GB/T 2406.2-2009, GB/T 2406.1-2008 | $\geq 32$  | 40.4       | 符合   |
| 4  | 电气性能    | 绝缘强度             | JG/T 3050-1998                     | 15min内不击穿。 | 15min内未击穿。 | 符合   |
|    |         | 绝缘电阻, M $\Omega$ | JG/T 3050-1998                     | $\geq 100$ | >100       | 符合   |

检测地址: 北京市房山区窦店镇亚新路17号;  
联系电话: 4000330789、010-60350462-8053。

(本页以下空白)

\*\*\*\*\* 结 束 \*\*\*\*\*



## 注意事项

## NOTICE

1. 报告无“检验检测专用章”或检验单位公章、骑缝章无效。

Test report is invalid without the "special seal for test report" or that of test department and perforated rider stamp on it.

2. 复制报告未重新加盖“检验检测专用章”或检验单位公章无效。

Duplication of test report is invalid without the "special seal for test report" or that of test department re-stamped on it.

3. 报告无主检、审核、批准签字无效。

Test report is invalid without the signatures of the persons for chief test, verification and approval.

4. 报告涂改无效。


Test report is invalid if altered.

5. 对检验报告若有异议，应于收到报告之日起十五日内向检验单位提出。

Any dissidence about the test report should be brought forward to the test department within 15 days from the date of receiving the test report.

6. 一般情况，委托检验仅对来样负责。

In general, for entrusted tests the responsibilities are undertaken for the delivered samples only.

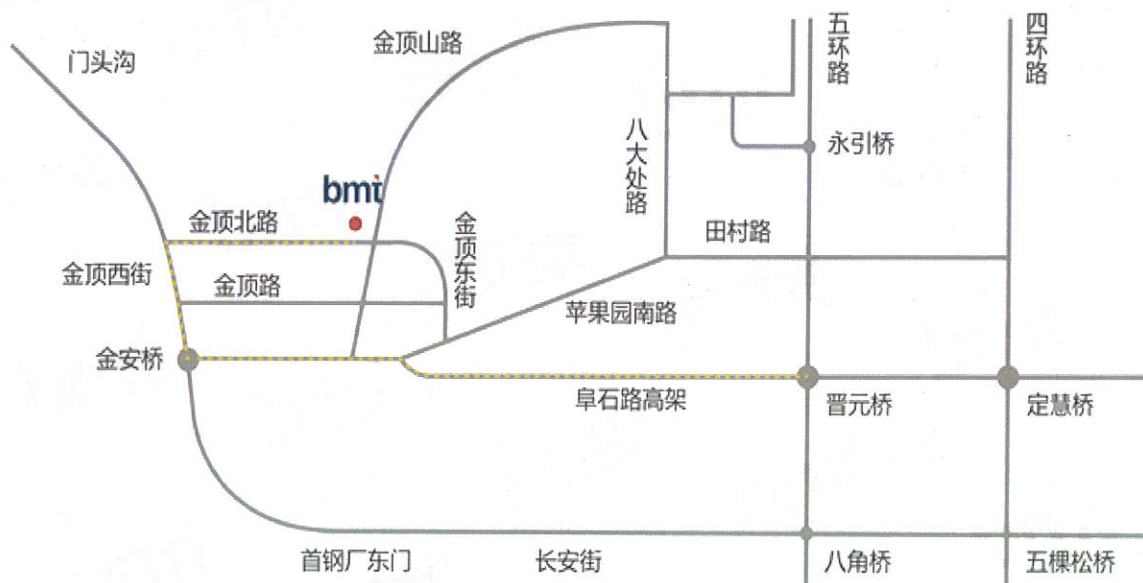

路线备注：沿阜石路高架向西行驶，见金顶西街出口进入辅路，金安桥下右转，第二个丁字路口（第一个红绿灯）右转，直行 600 米路北。



地址：北京市石景山区金顶北路69号(100041)

Add: No.69 JinDing North Road, Shijingshan District, Beijing, China 100041

网址(Web): www.bmtbj.cn

电话(Tel): 010-88724984 88749821

传真(Fax): 010-88715189

客服热线: 400-0330-789